

# Masonry



- Clay Masonry
- Concrete Masonry
- Autoclaved Aerated Concrete (AAC)

Höchst Entrance Hall, Frankfurt  
Arch: Peter Behrens, 1920-24  
Photo: Eva Kröcher



# Clay Brick

- Molded  
or
- Extruded
- Cored – adds stability, strength  
cored < 25% > hollow
- Fired (2000° F)
- Sizes – use 3/8" mortar bed
- Six ways to position in wall:

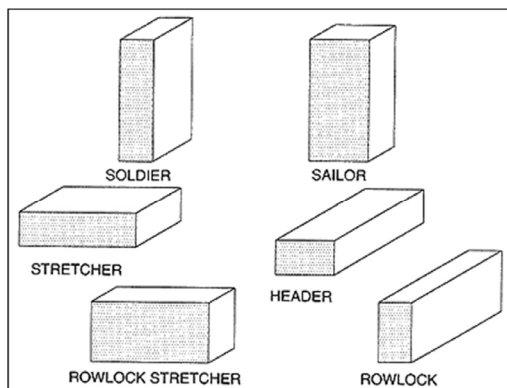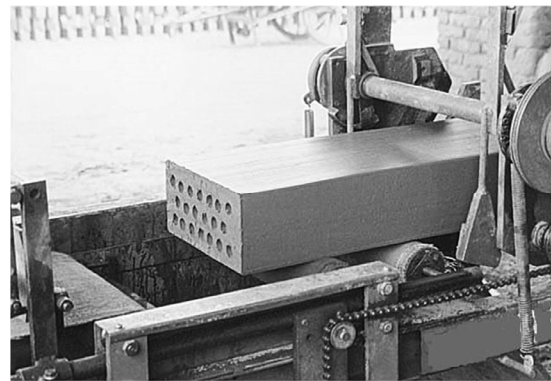

3/8" Mortar Joint Between Bricks (Most Common)

| BRICK TYPE | SPECIFIED SIZE D X H X L (INCHES) | NOMINAL SIZE D X H X L | VERTICAL COURSE |
|------------|-----------------------------------|------------------------|-----------------|
| Standard   | 3 5/8 x 2 1/4 x 8                 | Not modular            | 3 courses = 6"  |
| Modular    | 3 5/8 x 2 1/4 x 7 5/8             | 4 x 2 2/3 x 8          | 3 courses = 6"  |
| Norman     | 3 5/8 x 2 1/4 x 11 5/8            | 4 x 2 2/3 x 12         | 3 courses = 6"  |
| Roman      | 3 5/8 x 1 5/8 x 11 5/8            | 4 x 2 x 12             | 1 course = 2"   |
| Jumbo      | 3 5/8 x 2 3/4 x 8                 | 4 x 3 x 8              | 1 course = 3"   |
| Economy    | 3 5/8 x 3 5/8 x 7 5/8             | 4 x 4 x 8              | 1 course = 4"   |
| Engineer   | 3 5/8 x 2 13/16 x 7 5/8           | 4 x 3 1/5 x 8          | 5 courses = 16" |
| King       | 2 3/4 x 2 5/8 x 9 5/8             | Not modular            | 5 courses = 16" |
| Queen      | 2 3/4 x 2 3/4 x 7 5/8             | Not modular            | 5 courses = 16" |
| Utility    | 3 5/8 x 3 5/8 x 11 5/8            | 4 x 4 x 12             | 1 course = 4"   |

# Clay Brick




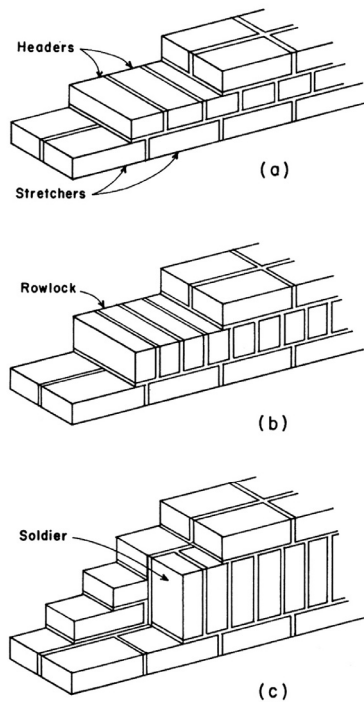


FIGURE 4.2. Ordinary positions for bricks.

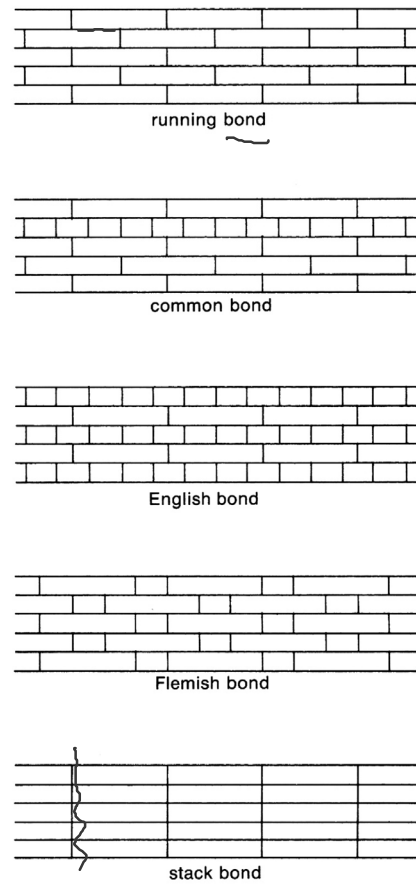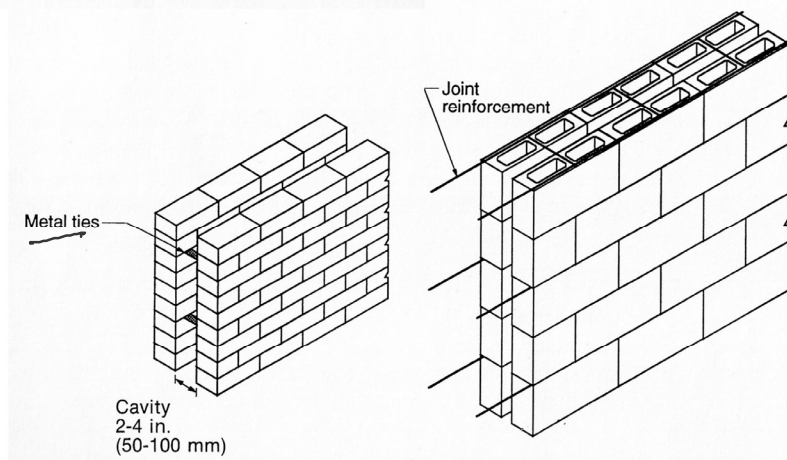

# Cavity Walls

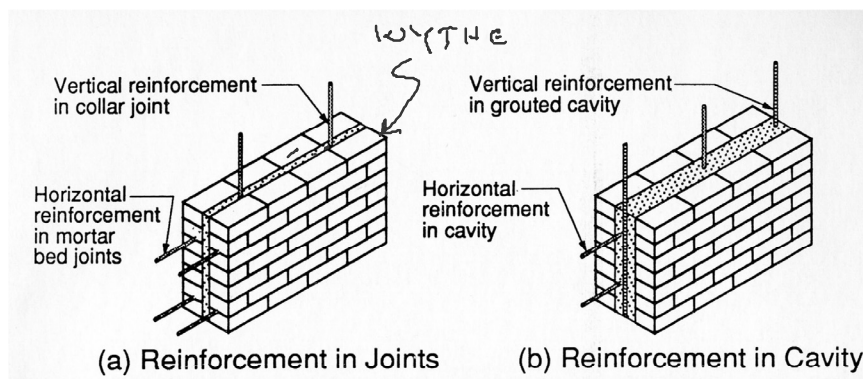


# Concrete Masonry Units (CMU) wall construction




## Concrete Masonry Units (CMU)

- wall sections

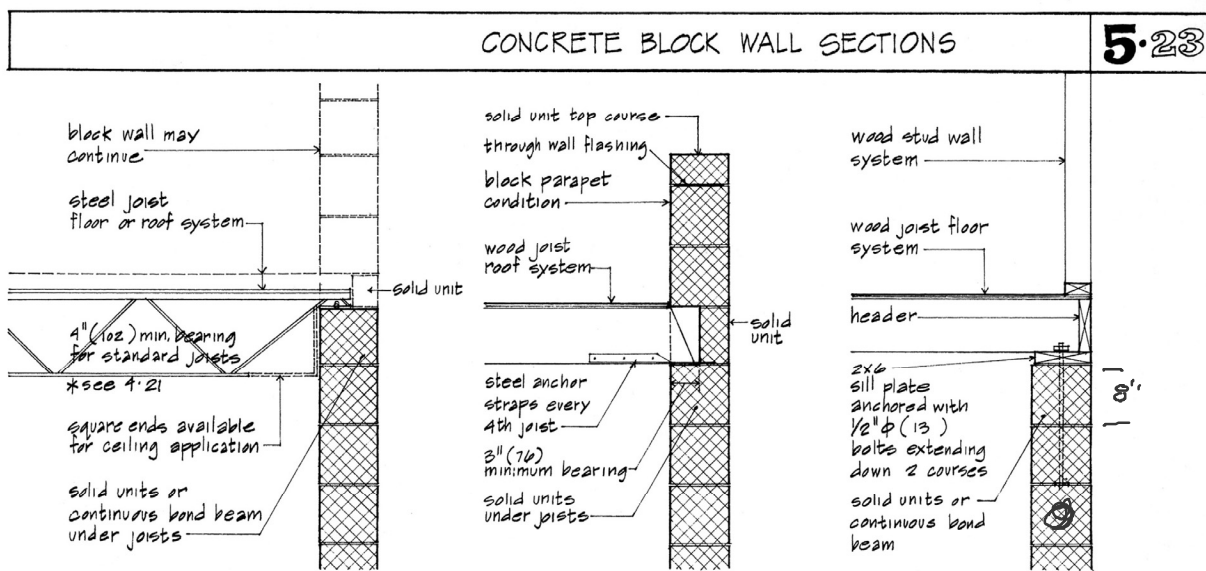

These wall sections are not intended to be complete. They exclude floor, wall, and ceiling finishes, trim, etc. They attempt to illustrate how various floor and roof systems are supported by a concrete block bearing wall. The above-grade wall is literally an extension of the concrete block foundation wall system. Note that the edges of floor and roof planes are not visible from the exterior except at the top of the concrete block wall. All vertical dimensions should be modular, especially if the block is left exposed as the wall finish.

# Concrete Masonry Units (CMU)

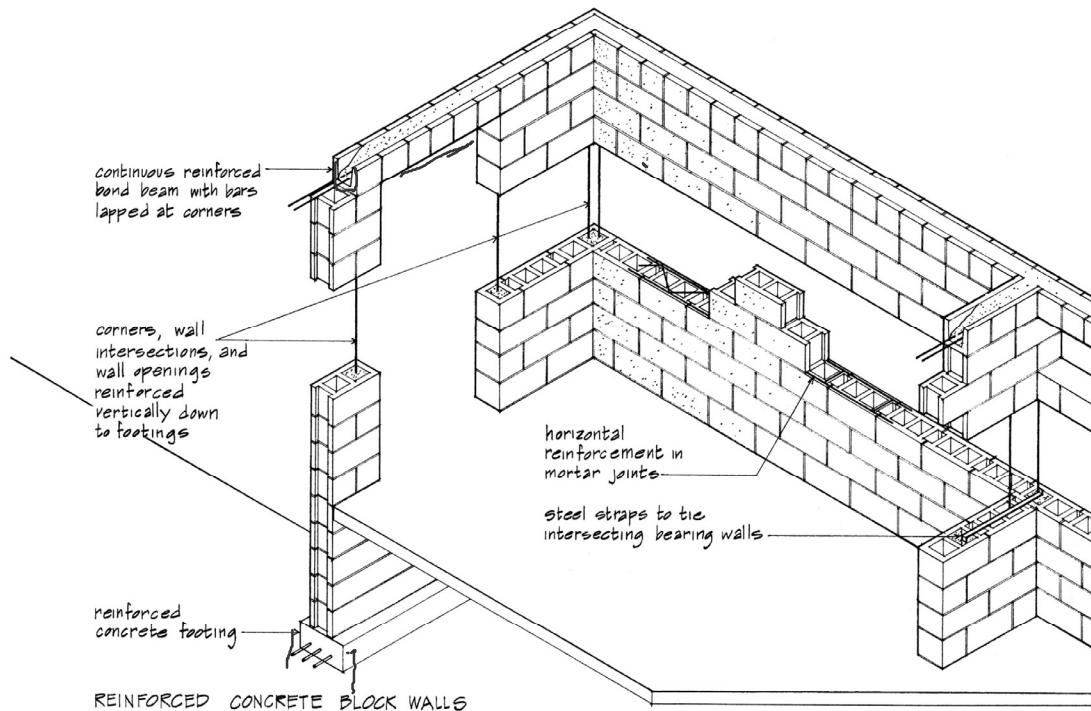

REINFORCED CONCRETE BLOCK WALLS

When concrete block walls are subjected to lateral forces such as caused by wind, earth pressure below grade, and earthquakes, they may be reinforced as illustrated above.

# Concrete Masonry Units (CMU)

- Cast (molds)
- Dried
- Autoclaved

## 1.9.1 Standard Concrete Masonry Unit (CMU) Stretchers and Unit Coring


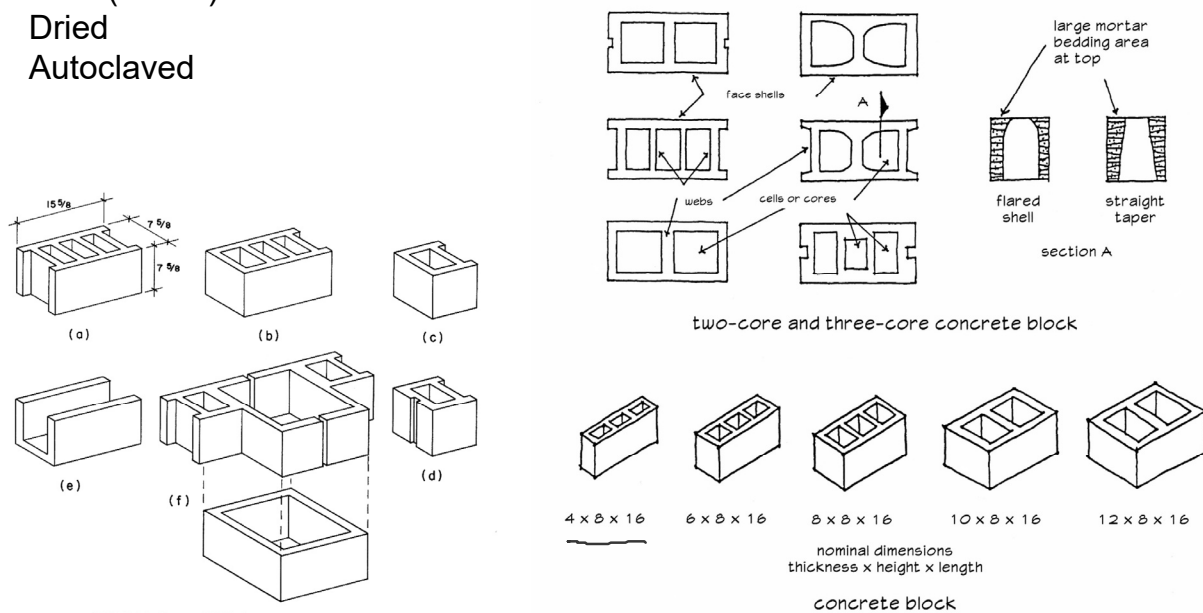


FIGURE 5.1. Forms of CMUs for unreinforced construction.

# Concrete Masonry Units (CMU)

- Geometric Properties
- NCMA TEK 14-1B
- Radius of gyration,  $r = \sqrt{\frac{I}{A}}$

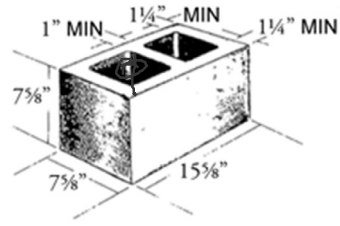

## 8-inch (203-mm) Single Wythe Walls, 1 1/4 in. (32 mm) Face Shells (standard)

| Horizontal Section Properties (Masonry Spanning Vertically) |                     |                |   |                              |                              |
|---|---------------------|----------------|---|------------------------------|------------------------------|
| Unit  | Grout spacing (in.) | Mortar bedding | Net cross-sectional properties <sup>A</sup> |                              |                              |
|   |                     |                | $A_n$ (in. <sup>2</sup> /ft)                | $I_n$ (in. <sup>4</sup> /ft) | $S_n$ (in. <sup>3</sup> /ft) |
| Hollow  | No grout            | Face shell     | 30.0  | 308.7                        | 81.0                         |
| Hollow  | No grout            | Full           | 41.5  | 334.0                        | 87.6                         |
| 100% solid/solidly grouted                                  |                     | Full           | 91.5  | 443.3                        | 116.3                        |
| Hollow  | 16                  | Face shell     | 62.0  | 378.6                        | 99.3                         |
| Hollow  | 24                  | Face shell     | 51.3  | 355.3                        | 93.2                         |
| Hollow  | 32                  | Face shell     | 46.0  | 343.7                        | 90.1                         |
| Hollow  | 40                  | Face shell     | 42.8  | 336.7                        | 88.3                         |
| Hollow  | 48                  | Face shell     | 40.7  | 332.0                        | 87.1                         |
| Hollow  | 72                  | Face shell     | 37.1  | 324.3                        | 85.0                         |
| Hollow  | 96                  | Face shell     | 35.3  | 320.4                        | 84.0                         |
| Hollow  | 120                 | Face shell     | 34.3  | 318.0                        | 83.4                         |


# Concrete Masonry Units (CMU)

- Reinforcing

### Joint Reinforcing



Truss Type



Ladder Type


4.5 Horizontal reinforcement required for masonry not laid in running bond of  $0.00028A_g$ , placed at a maximum spacing of 48 in. o.c. in horizontal mortar joints or in bond beams.

$$0.00028 \left( \frac{A_g}{w \cdot L} \right) (16) = 0.034 \text{ in}^2$$

Use 9 gage (W1.7) at 16 in. o.c.

W1.7 wire  
dia. = 0.147 in  
area = 0.017 in<sup>2</sup>  
2x wire = 0.034 in<sup>2</sup>

### Rebar Positioners



Placed in mortar joints




Concrete Masonry Units



Placed in cells



# Concrete Masonry Construction

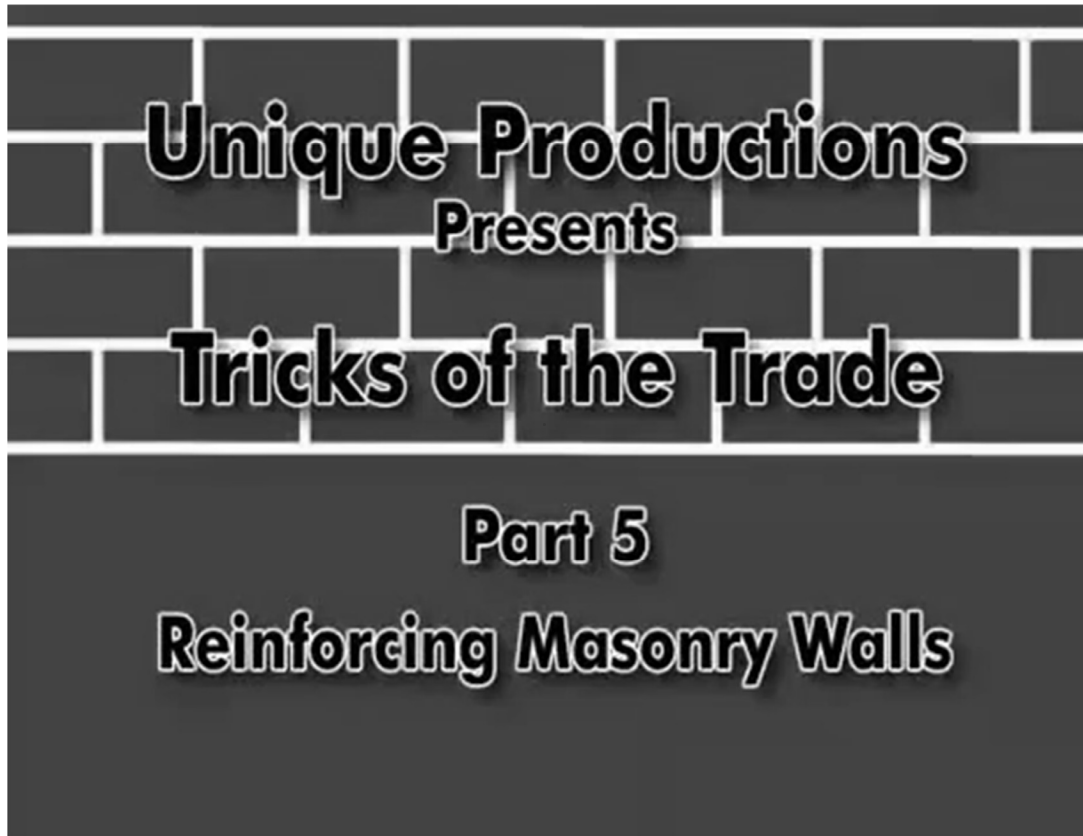

## Mortar Types

Types M, S, N, O

The following mortar designations took effect in the mid-1950's:

**M**   a   **S**   o   **N**   w   **O**   r   **K**  
 strongest weakest



**Table 2-3. Guide to the Selection of Mortar Type\***

| Location                    | Building segment  | Mortar type |             |
|-----------------------------|---|-------------|-------------|
|                             |   | Recommended | Alternative |
| Exterior, above grade       | Load-bearing walls  | N           | S or M      |
|                             | Non-load-bearing walls  | O**         | N or S      |
|                             | Parapet walls   | N           | S           |
| Exterior, at or below grade | Foundation walls, retaining walls, manholes, sewers, pavements, walks, and patios | S†          | M or N†     |
| Interior                    | Load-bearing walls  | N           | S or M      |
|                             | Non-load-bearing partitions   | O           | N           |

\*Adapted from ASTM C270. This table does not provide for specialized mortar uses, such as chimney, reinforced masonry, and acid-resistant mortars.

\*\*Type O mortar is recommended for use where the masonry is unlikely to be frozen when saturated or unlikely to be subjected to high winds or other significant lateral loads. Type N or S mortar should be used in other cases.

†Masonry exposed to weather in a nominally horizontal surface is extremely vulnerable to weathering. Mortar for such masonry should be selected with due caution.

Note: For tuckpointing mortar, see "Tuckpointing," Chapter 9.

*Relative Parts by Volume*


| mortar type | Portland cement | lime          | sand           |
|-------------|-----------------|---------------|----------------|
| M           | 1               | $\frac{1}{4}$ | $3\frac{1}{2}$ |
| S           | 1               | $\frac{1}{2}$ | $4\frac{1}{2}$ |
| N           | 1               | 1             | 6              |
| O           | 1               | 2             | 9              |

sum should equal 1/3 of sand volume  
 (assuming that sand has void ratio of 1 in 3)


# Mortar Types

Type M, S, N, O

Slump is higher than cast concrete based on workability

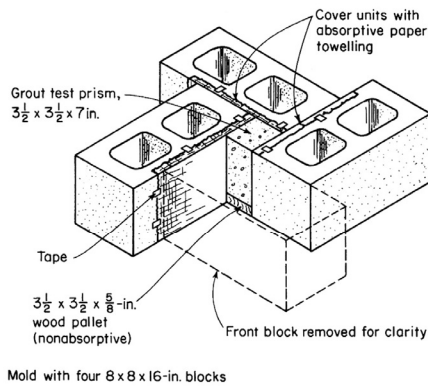

**Fig. 2-29.** ASTM C1019 method of using masonry units to form a prism for compression-testing of masonry grout.

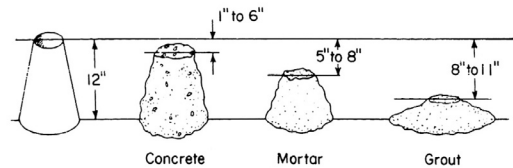


**Fig. 2-27.** Slump test comparison of concrete, mortar, and masonry grout.

# Masonry Strength

Masonry strength,  $f'_m$ , based on unit strength,  $f_u$ , and mortar type



Clay Masonry



Concrete Masonry

| Required Net Area Compressive Strength of Clay Masonry Units (psi) $f_u$ |                              | $f'_m$<br>For Net Area Compressive Strength of Masonry (psi) |
|--|------------------------------|--|
| When Used With Type M or S Mortar  | When Used With Type N Mortar |  |
| 1,700  | 2,100                        | 1,000  |
| 3,350  | 4,150                        | 1,500  |
| 4,950  | 6,200                        | 2,000  |
| 6,600  | 8,250                        | 2,500  |
| 8,250  | 10,300                       | 3,000  |
| 9,900  | --                           | 3,500  |
| 11,500   | --                           | 4,000  |

(From *Masonry Standards Joint Committee Specifications for Masonry Structures*, ACI 530.1/ASCE 6/TMS 602-99)

| Required Net Area Compressive Strength of Concrete Masonry Units (psi) $f_u$ |                              | $f'_m$<br>For Net Area Compressive Strength of Masonry (psi) |
|--|------------------------------|--|
| When Used With Type M or S Mortar  | When Used With Type N Mortar |  |
| 1,250  | 1,300                        | 1,000  |
| 1,900  | 2,150                        | 1,500  |
| 2,800  | 3,050                        | 2,000  |
| 3,750  | 4,050                        | 2,500  |
| 4,800  | 5,250                        | 3,000  |

(From *International Building Code 2000 and Masonry Standards Joint Committee Specifications for Masonry Structures*, ACI 530.1/ASCE 6/TMS 602-99)

# Constructive Properties

## Typical Values


| Property           |        | Clay Masonry                  | Concrete Masonry              |
|--------------------|--------|-------------------------------|-------------------------------|
| Unit strength      |        | 8000 <i>psi</i>               | 2000 <i>psi</i>               |
| Type N mortar      | $f'_m$ | 2440 <i>psi</i>               | 1750 <i>psi</i>               |
|                    | $E_m$  | $1.70 \times 10^6$ <i>psi</i> | $1.58 \times 10^6$ <i>psi</i> |
| Type M or S mortar | $f'_m$ | 2920 <i>psi</i>               | 2000 <i>psi</i>               |
|                    | $E_m$  | $2.05 \times 10^6$ <i>psi</i> | $1.80 \times 10^6$ <i>psi</i> |

| Property                     | Clay Masonry                            | Concrete Masonry                        |
|------------------------------|---|---|
| Modulus of Elasticity, $E_m$ | $700f'_m$                               | $900f'_m$                               |
| Shear Modulus, $G$           | $0.4E_m$                                | $0.4E_m$                                |
| Coefficient of Creep         | $\frac{0.7 \times 10^{-7}}{\text{psi}}$ | $\frac{2.5 \times 10^{-7}}{\text{psi}}$ |

## Analysis and Design

### Empirical approach

- based on experience
- limits on lateral loading
- limits on height
- limits on eccentricity (basically no flexure)
- non-reinforced

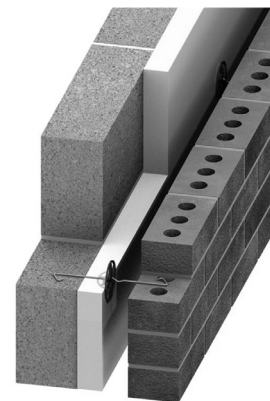

### Rational approach

- based on Strength Design (LRFD)
- either reinforced or non-reinforced
- limited by strength





# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design (LRFD) – non-reinforced

## Rational Approach

Given: geometry, material

Find: axial compressive load capacity,  $P_n$

1. Determine the masonry strength,  $f'_m$ , based on unit strength,  $f_u$ , and mortar type
2. Find the net area,  $A_n$ , and Moment of Inertia,  $I_n$  (see NCMA TEK 14-1B)
3. Calculate  $r = \sqrt{I_n/A}$
4. Calculate  $h/r$
5. Choose the axial strength equation,  $P_n$ :  
If  $h/r < 99$  use TMS 402 eq.9-11  
If  $h/r > 99$  use TMS 402 eq.9-12
6. Calculate  $\phi P_n$  where  $\phi$  for axial force = 0.90
7. Check that  $\phi P_n$  is greater than  $P_u$ .

(Equation 9-11) for  $h/r < 99$

$$P_n = 0.80 \left\{ 0.80 A_n f'_m \left[ 1 - \left( \frac{h}{140r} \right)^2 \right] \right\}$$

(Equation 9-12) for  $h/r > 99$


$$P_n = 0.80 \left[ 0.80 A_n f'_m \left( \frac{70r}{h} \right)^2 \right]$$

## Masonry Strength

Masonry strength,  $f'_m$ , based on unit strength,  $f_u$ , and mortar type



Clay Masonry



Concrete Masonry

| Required Net Area Compressive Strength of Clay Masonry Units (psi) $f_u$ |                              | $f'_m$<br>For Net Area Compressive Strength of Masonry (psi) |
|--|------------------------------|--|
| When Used With Type M or S Mortar  | When Used With Type N Mortar |  |
| 1,700  | 2,100                        | 1,000  |
| 3,350  | 4,150                        | 1,500  |
| 4,950  | 6,200                        | 2,000  |
| 6,600  | 8,250                        | 2,500  |
| 8,250  | 10,300                       | 3,000  |
| 9,900  | ---                          | 3,500  |
| 11,500   | ---                          | 4,000  |

(From Masonry Standards Joint Committee Specifications for Masonry Structures, ACI 530.1/ASCE 6/TMS 602-99)

| Required Net Area Compressive Strength of Concrete Masonry Units (psi) $f_u$ |                              | $f'_m$<br>For Net Area Compressive Strength of Masonry (psi) |
|--|------------------------------|--|
| When Used With Type M or S Mortar  | When Used With Type N Mortar |  |
| 1,250  | 1,300                        | 1,000  |
| 1,900  | 2,150                        | 1,500  |
| 2,800  | 3,050                        | 2,000  |
| 3,750  | 4,050                        | 2,500  |
| 4,800  | 5,250                        | 3,000  |


(From International Building Code 2000 and Masonry Standards Joint Committee Specifications for Masonry Structures, ACI 530.1/ASCE 6/TMS 602-99)

# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design – **non-reinforced**

## Rational Approach

### Section Properties of Concrete Masonry Walls NCMA TEK 14 – 1B

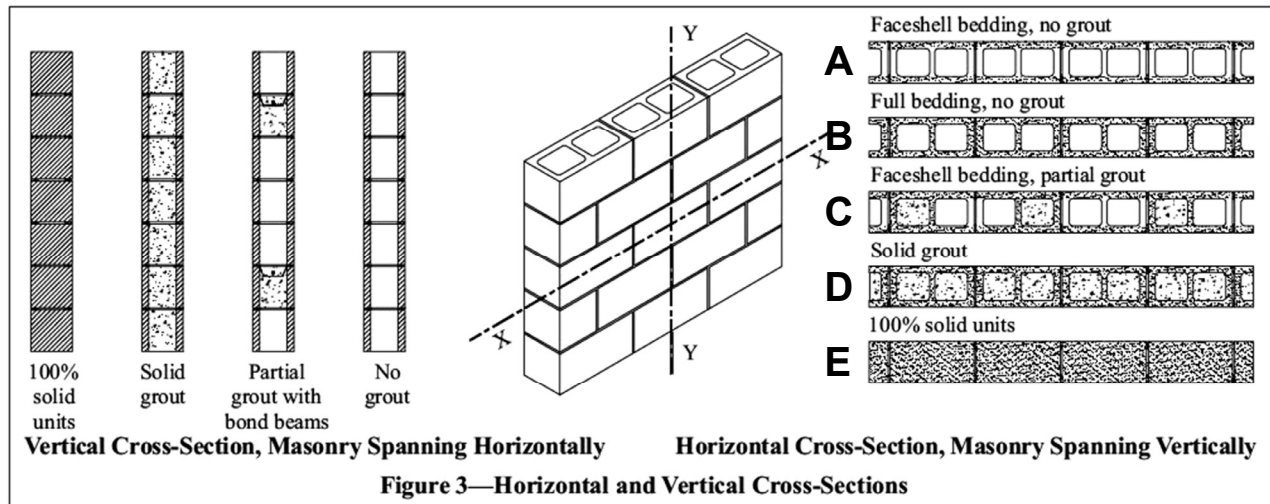

# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design – **non-reinforced**

## Rational Approach

### Section Properties of Concrete Masonry Walls NCMA TEK 14 – 1B

**Table 3—8-inch (203-mm) Single Wythe Walls, 1¼ in. (32 mm) Face Shells (standard)**

| <b>3a: Horizontal Section Properties (Masonry Spanning Vertically)</b> |                     |                |   |                              |                              |  |
|--|---------------------|----------------|---|------------------------------|------------------------------|--|
| Unit   | Grout spacing (in.) | Mortar bedding | Net cross-sectional properties <sup>A</sup> |                              |                              |  |
|  |                     |                | $A_n$ (in. <sup>2</sup> /ft)                | $I_n$ (in. <sup>4</sup> /ft) | $S_n$ (in. <sup>3</sup> /ft) |  |
| <b>A</b> Hollow  | No grout            | Face shell     | 30.0  | 308.7                        | 81.0                         |  |
| <b>B</b> Hollow  | No grout            | Full           | 41.5  | 334.0                        | 87.6                         |  |
| <b>D/E</b> 100% solid/solidly grouted                                  |                     | Full           | 91.5  | 443.3                        | 116.3                        |  |
| <b>C</b> Hollow  | 16                  | Face shell     | 62.0  | 378.6                        | 99.3                         |  |
| Hollow   | 24                  | Face shell     | 51.3  | 355.3                        | 93.2                         |  |
| Hollow   | 32                  | Face shell     | 46.0  | 343.7                        | 90.1                         |  |
| Hollow   | 40                  | Face shell     | 42.8  | 336.7                        | 88.3                         |  |
| Hollow   | 48                  | Face shell     | 40.7  | 332.0                        | 87.1                         |  |
| Hollow   | 72                  | Face shell     | 37.1  | 324.3                        | 85.0                         |  |
| Hollow   | 96                  | Face shell     | 35.3  | 320.4                        | 84.0                         |  |
| Hollow   | 120                 | Face shell     | 34.3  | 318.0                        | 83.4                         |  |

# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design – **non-reinforced**


## Rational Approach

### Example Problem

Given: geometry: 8" block, grouted 24" o.c.  
material:  $f'_m = 3000$  psi  
Find: check pass/fail for the given loading

1. Determine the masonry strength,  $f'_m$ , based on unit strength,  $f_u$ , and mortar type. (given  $f'_m = 3000$  psi)

Faceshell bedding, partial grout

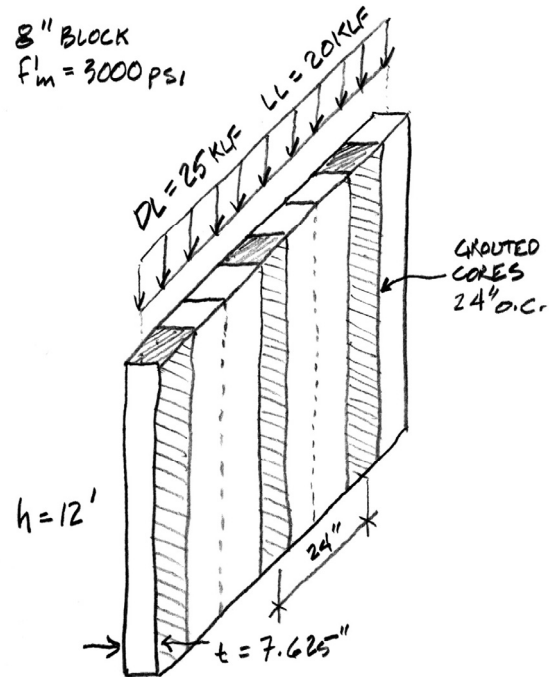

# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design – **non-reinforced**

## Rational Approach

2. Find the net area,  $A_n$ , and Moment of Inertia,  $I_n$  (see NCMA TEK 14-1B)

Table 3—8-inch (203-mm) Single Wythe Walls, 1 $\frac{1}{4}$  in. (32 mm) Face Shells (standard)

| 3a: Horizontal Section Properties (Masonry Spanning Vertically) |                     |                |   |                              |                              |
|---|---------------------|----------------|---|------------------------------|------------------------------|
| Unit  | Grout spacing (in.) | Mortar bedding | Net cross-sectional properties <sup>A</sup> |                              |                              |
|   |                     |                | $A_n$ (in. <sup>2</sup> /ft)                | $I_n$ (in. <sup>4</sup> /ft) | $S_n$ (in. <sup>3</sup> /ft) |
| Hollow  | No grout            | Face shell     | 30.0  | 308.7                        | 81.0                         |
| Hollow  | No grout            | Full           | 41.5  | 334.0                        | 87.6                         |
| 100% solid/solidly grouted                                      |                     | Full           | 91.5  | 443.3                        | 116.3                        |
| Hollow  | 16                  | Face shell     | 62.0  | 378.6                        | 99.3                         |
| Hollow  | 24                  | Face shell     | 51.3  | 355.3                        | 93.2                         |
| Hollow  | 32                  | Face shell     | 46.0  | 343.7                        | 90.1                         |
| Hollow  | 40                  | Face shell     | 42.8  | 336.7                        | 88.3                         |
| Hollow  | 48                  | Face shell     | 40.7  | 332.0                        | 87.1                         |
| Hollow  | 72                  | Face shell     | 37.1  | 324.3                        | 85.0                         |
| Hollow  | 96                  | Face shell     | 35.3  | 320.4                        | 84.0                         |
| Hollow  | 120                 | Face shell     | 34.3  | 318.0                        | 83.4                         |

# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design – **non-reinforced**

## Rational Approach

3. Calculate  $r = \sqrt{I/A}$

TEK 14-1B 8" SINGLE WYTHE  
HOLLOW BLOCK - GROUT @ 24" o.c. - FACE SHELL MORTAR  
 $A_n = 51.3 \text{ in}^2$   $I_n = 355.3 \text{ in}^4$  (NET)

4. Calculate  $h/r$

$$r = \sqrt{\frac{I}{A}} = \sqrt{\frac{355.3}{51.3}} = 1.952 \text{ in}$$

$$\frac{h}{r} = \frac{12'(12)}{1.952} = 73.75 < 99 \therefore \text{Eq ①}$$

5. Choose the axial strength equation,  $P_n$ :

If  $h/r < 99$  use TMS 402 eq.9-11

If  $h/r > 99$  use TMS 402 eq.9-12

(Equation 9-11) for  $h/r < 99$

$$P_n = 0.80 \left\{ 0.80 A_n f'_m \left[ 1 - \left( \frac{h}{140r} \right)^2 \right] \right\}$$

# Reinforced Masonry Analysis

for axial compression using TMS 402 (2016)  
Strength Design – **non-reinforced**

## Rational Approach

(Equation 9-11) for  $h/r < 99$

$$P_n = 0.80 \left\{ 0.80 A_n f'_m \left[ 1 - \left( \frac{h}{140r} \right)^2 \right] \right\}$$

6. Calculate  $\phi P_n$   
where  $\phi$  for axial force = 0.90

$$P_n = 0.8 \left[ 0.8 A_n f'_m \left( 1 - \left( \frac{h}{140r} \right)^2 \right) \right]$$

$$P_n = 0.8 \left[ 0.8 (51.3) (3) \left( 1 - \left( \frac{144}{140(1.952)} \right)^2 \right) \right]$$

$$P_n = 0.8 [123.12 - 0.7223] = 71.4 \text{ k/ft}$$

$$\phi P_n = 0.9 (71.4) = 64 \text{ k/ft}$$

7. Check that  $\phi P_n$  is greater than  $P_u$ .


$$P_u = 1.2(25) + 1.6(20) = 62 \text{ k/ft}$$

$$P_u = 62 \text{ k/ft} < 64 \text{ k/ft} = \phi P_n \therefore \text{OK} \checkmark$$

# Lateral Force Resistance

Stability requires at least 2 points of intersection.

Force is more evenly resisted with centroid of walls in the kern of slab

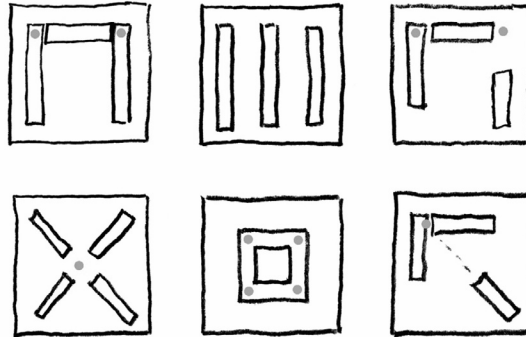

## Empirical Approach

TMS 402-16 Tab. CC A.1.1  
Checklist for use of empirical design

### COMMENTARY

Table CC-A.1.1 — Checklist for use of Appendix A – Empirical Design of Masonry

|     |   |                       |  |
|-----|---|-----------------------|--|
| 1.  | Risk Category IV structures, or portions thereof, are not permitted to be designed using Appendix A.  |                       |  |
| 2.  | Partitions are not permitted to be designed using Appendix A.   |                       |  |
| 3.  | Use of empirical design is limited based on Seismic Design Category, as described in the following table.   |                       |  |
|     | Seismic Design Category   | Participating Walls   | Non-Participating Walls, except partition walls          |
|     | A   | Allowed by Appendix A | Allowed by Appendix A                                    |
|     | B   | Not Allowed           | Allowed by Appendix A                                    |
|     | C   | Not Allowed           | With prescriptive reinforcement per 7.4.3.1 <sup>1</sup> |
|     | D, E, and F   | Not Allowed           | Not Allowed  |
|     | <sup>1</sup> Lap splices are required to be designed and detailed in accordance with the requirements of Chapters 8 or 9.   |                       |  |
| 4.  | Use of empirical design is limited based on wind speed at the project site, as described in Code A.1.2.3 and Code Table A.1.1.  |                       |  |
| 5.  | If wind uplift on roofs result in net tension, empirical design is not permitted (A.8.3.1).   |                       |  |
| 6.  | Loads used in the design of masonry must be listed on the design drawings (1.2.1b).   |                       |  |
| 7.  | Details of anchorage to structural frames must be included in the design drawings (1.2.1e).   |                       |  |
| 8.  | The design is required to include provisions for volume change (1.2.1h). The design drawings are required to include the locations and sizing of expansion, control, and isolation joints.  |                       |  |
| 9.  | If walls are connected to structural frames, the connections and walls are required to be designed to resist the interconnecting forces and to accommodate deflections (4.4).<br><br>This provision requires a lateral load and uplift analysis for exterior walls that receive wind load and are supported by or are supporting a frame or roofing system. |                       |  |
| 10. | Masonry not laid in running bond (for example, stack bond masonry) is required to have horizontal reinforcement (4.5).  |                       |  |
| 11. | A project quality assurance plan is required (3.1) with minimum requirements given in TMS 602 Tables 3 and 4 for Quality Assurance Level 1.   |                       |  |
| 12. | The resultant of gravity loads must be determined and assured to be located within certain limitations for walls and piers (A.1.2.1).   |                       |  |
| 13. | Ensure compliance of the design with prescriptive floor, roof, and wall-to-structural framing anchorage requirements, as well as other anchorage requirements (A.8.3 and A.8.4).  |                       |  |
| 14. | Type N mortar is not permitted for foundation walls (A.6.3.1(g)).   |                       |  |
| 15. | Design shear wall lengths, spacings, and orientations to meet the requirements of Code A.3.1.   |                       |  |

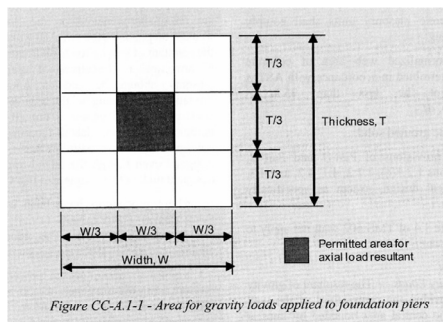


Figure CC-A.1-1 - Area for gravity loads applied to foundation piers

# Empirical Approach

## Wind limitations:

Basic wind speed  $\leq 115$  mph  
(see TMS 402-16 Tab. A.1.1)

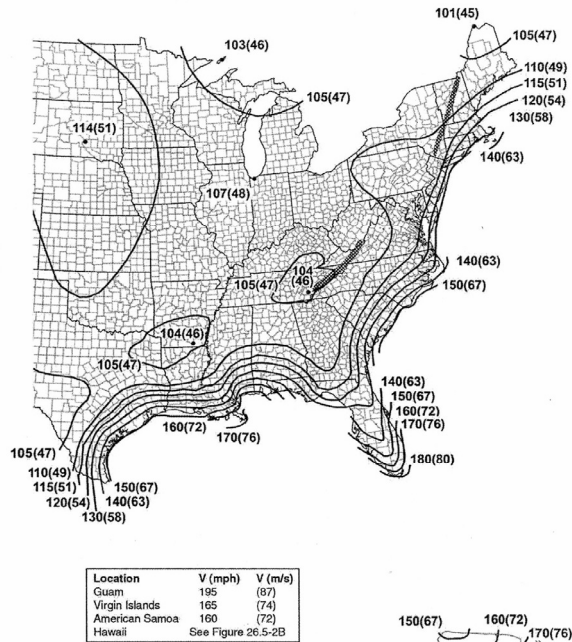



FIGURE 26.5-1B (Continued). Basic Wind Speeds for Risk Category II Buildings and Other Structures

ASCE 7 – 2016 basic wind speeds for risk cat. II

University of Michigan, TCAUP

## Seismic limitations:

Can generally be used for Seismic Design Category (SDC) A, B, or C, or only A if part of the seismic lateral force resisting system.

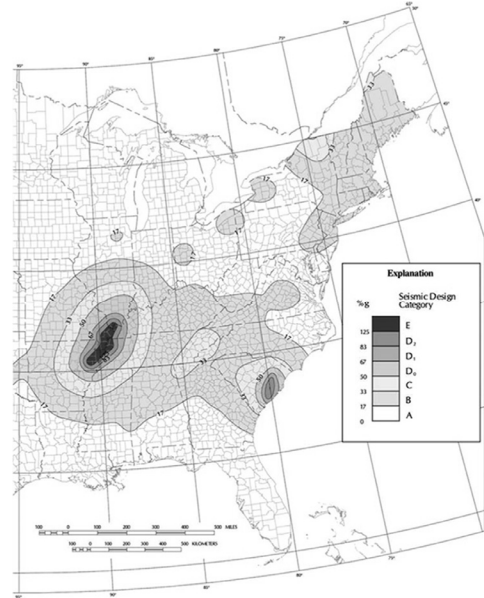

Seismic zones A-E

Structures II

Slide 27 of 46

# Empirical Design of Masonry

TMS 402-16

## Height limits by wind speed and application

Table A.1.1 Limitations based on building height and basic wind speed

| Element Description   | Building Height, ft (m)                         | Basic Wind Speed, mph (mps) <sup>1</sup> |  |  |               |
|---|---|--|--|--|---------------|
|   |   | Less than or equal to 115 (51)           | Over 115 (51) and less than or equal to 120 (54) | Over 120 (54) and less than or equal to 125 (56) | Over 125 (56) |
| Masonry elements that are part of the lateral-force-resisting system  | 35 (11) and less                                | Permitted                                |  |  | Not Permitted |
| Interior masonry loadbearing elements that are not part of the lateral-force-resisting system in buildings other than enclosed as defined by ASCE 7 | Over 180 (55)                                   | Not Permitted                            |  |  |               |
|   | Over 60 (18) and less than or equal to 180 (55) | Permitted                                | Not Permitted                                    |  |               |
|   | Over 35 (11) and less than or equal to 60 (18)  | Permitted                                |  | Not Permitted                                    |               |
| Exterior masonry elements that are not part of the lateral-force-resisting system   | 35 (11) and less                                | Permitted                                |  |  | Not Permitted |
|   | Over 180 (55)                                   | Not Permitted                            |  |  |               |
|   | Over 60 (18) and less than or equal to 180 (55) | Permitted                                | Not Permitted                                    |  |               |
| Exterior masonry elements   | Over 35 (11) and less than or equal to 60 (18)  | Permitted                                |  | Not Permitted                                    |               |
|   | 35 (11) and less                                | Permitted                                |  |  | Not Permitted |

<sup>1</sup>Basic wind speed as given in ASCE 7

University of Michigan, TCAUP

Structures II

Slide 28 of 46

# Empirical Design of Masonry TEK 14-8B (also TMS 402 – Tab. A.5.1)

International Building Code (IBC) Limitations:

1. Lateral support requirements
2. Location of gravity load (in middle 1/3 of wall)
3. Maximum unreinforced spans

| Table 2—Wall Lateral Support Requirements (ref. 1) |  | Table 3—Maximum Unreinforced Wall Spans, ft (m) <sup>A</sup> |                       |            |            |          |
|--|--|--|-----------------------|------------|------------|----------|
| Construction (unreinforced)                        | Maximum wall length-to-thickness or height-to-thickness ratio <sup>A</sup> | Wall thickness, in. (mm)                                     | 6 (152)               | 8 (203)    | 10 (254)   | 12 (305) |
| <b>Bearing walls</b>                               |  | <b>Bearing walls</b>   |                       |            |            |          |
| Solid units or solid grouted                       | 20   | Solid or solid grouted                                       | 10 (3.0) <sup>B</sup> | 13.3 (4.1) | 16.6 (5.1) | 20 (6.1) |
| All others   | 18   | All other  | 9 (2.7) <sup>B</sup>  | 12 (3.7)   | 15 (4.5)   | 18 (5.5) |
| <b>Nonbearing walls</b>                            |  | <b>Nonbearing walls</b>                                      |                       |            |            |          |
| Exterior   | 18   | Exterior   | 9 (2.7)               | 12 (3.7)   | 15 (4.5)   | 18 (5.5) |
| Interior   | 36   | Interior   | 18 (5.5)              | 24 (7.3)   | 30 (9.1)   | 36 (11)  |
| <b>Cantilever walls<sup>B</sup></b>                |  | <b>Cantilever Walls<sup>C</sup></b>                          |                       |            |            |          |
| Solid  | 6  | Solid  | 3 (0.9)               | 4 (1.2)    | 5 (1.5)    | 6 (1.8)  |
| Hollow   | 4  | Hollow   | 2 (0.6)               | 2.6 (0.8)  | 3.3 (1.0)  | 4 (1.2)  |
| Parapets (8-in. (203-mm) thick min.) <sup>B</sup>  | 3  | Parapets <sup>C</sup>  | 1.5 (0.5)             | 2 (0.6)    | 2.5 (0.8)  | 3 (0.9)  |

<sup>A</sup> Ratios are determined using nominal dimensions. For multiwythe walls where wythes are bonded by masonry headers, the thickness is the nominal wall thickness. When multiwythe walls are bonded by metal wall ties, the thickness is taken as the sum of the wythe thicknesses. Note that Reference 6 includes modified requirements for walls with openings.

<sup>B</sup> The ratios are maximum height-to-thickness ratios and do not limit wall length.


<sup>C</sup> For these cases, spans are maximum wall heights.

## Masonry Strength

Masonry strength,  $f'_m$ , based on unit strength,  $f_u$ , and mortar type



Clay Masonry



Concrete Masonry

| Required Net Area Compressive Strength of Clay Masonry Units (psi) $f_u$ |                              | $f'_m$<br>For Net Area Compressive Strength of Masonry (psi) |
|--|------------------------------|--|
| When Used With Type M or S Mortar  | When Used With Type N Mortar |  |
| 1,700  | 2,100                        | 1,000  |
| 3,350  | 4,150                        | 1,500  |
| 4,950  | 6,200                        | 2,000  |
| 6,600  | 8,250                        | 2,500  |
| 8,250  | 10,300                       | 3,000  |
| 9,900  | --                           | 3,500  |
| 11,500   | --                           | 4,000  |

(From Masonry Standards Joint Committee Specifications for Masonry Structures, ACI 530.1/ASCE 6/TMS 602-99)

| Required Net Area Compressive Strength of Concrete Masonry Units (psi) $f_u$ |                              | $f'_m$<br>For Net Area Compressive Strength of Masonry (psi) |
|--|------------------------------|--|
| When Used With Type M or S Mortar  | When Used With Type N Mortar |  |
| 1,250  | 1,300                        | 1,000  |
| 1,900  | 2,150                        | 1,500  |
| 2,800  | 3,050                        | 2,000  |
| 3,750  | 4,050                        | 2,500  |
| 4,800  | 5,250                        | 3,000  |

(From International Building Code 2000 and Masonry Standards Joint Committee Specifications for Masonry Structures, ACI 530.1/ASCE 6/TMS 602-99)

# Empirical Design of Masonry TEK 14-8B (also TMS 402 – Tab. A.4.2)

Allowable compressive stress of concrete masonry:

Solid or solidly grouted walls

| Gross area compressive strength of unit, psi (MPa)             | Allowable compressive stresses based on gross cross-sectional area, psi (MPa) <sup>A</sup> |               |
|--|--|---------------|
|  | Type M or S mortar   | Type N mortar |
| <b>Solid and Solidly Grouted Masonry (refs. 1, 6):</b>         |  |               |
| <b>Solid concrete brick:</b>                                   |  |               |
| 8,000 (55) or greater  | 350 (2.41)   | 300 (2.07)    |
| 4,500 (31)   | 225 (1.55)   | 200 (1.38)    |
| 2,500 (17)   | 160 (1.10)   | 140 (0.97)    |
| 1,500 (10)   | 115 (0.79)   | 100 (0.69)    |
| <b>Grouted concrete masonry:</b>                               |  |               |
| 4,500 (31) or greater  | 225 (1.55)   | 200 (1.38)    |
| 2,500 (17)   | 160 (1.10)   | 140 (0.97)    |
| 1,500 (10)   | 115 (0.79)   | 100 (0.69)    |
| <b>Solid concrete masonry units:</b>                           |  |               |
| 3,000 (21) or greater  | 225 (1.55)   | 200 (1.38)    |
| 2,000 (14)   | 160 (1.10)   | 140 (0.97)    |
| 1,200 (8.3)  | 115 (0.79)   | 100 (0.69)    |
| <b>Hollow walls (noncomposite masonry bonded<sup>B</sup>):</b> |  |               |
| <b>Solid units:</b>  |  |               |
| 2,500 (17) or greater  | 160 (1.10)   | 140 (0.97)    |
| 1,500 (10)   | 115 (0.79)   | 100 (0.69)    |

Hollow unit walls

| Gross area compressive strength of unit, psi (MPa)  | Allowable compressive stresses based on gross cross-sectional area, psi (MPa) <sup>A</sup> |               |
|---|--|---------------|
|   | Type M or S mortar   | Type N mortar |
| <b>Hollow Unit Masonry (Units Complying With ASTM C 90-06 or Later) (ref. 6)<sup>C</sup>:</b>     |  |               |
| <b>Hollow loadbearing CMU, <math>t \leq 8</math> in. (203 mm)<sup>D</sup>:</b>                    |  |               |
| 2,000 (14) or greater   | 140 (0.97)   | 120 (0.83)    |
| 1,500 (10)  | 115 (0.79)   | 100 (0.69)    |
| 1,000 (6.9)   | 75 (0.52)  | 70 (0.48)     |
| 700 (4.8)   | 60 (0.41)  | 55 (0.38)     |
| <b>Hollow loadbearing CMU, 8 in. <math>&lt; t &lt; 12</math> in. (203 to 305 mm)<sup>D</sup>:</b> |  |               |
| 2,000 (14) or greater   | 125 (0.86)   | 110 (0.76)    |
| 1,500 (10)  | 105 (0.72)   | 90 (0.62)     |
| 1,000 (6.9)   | 65 (0.49)  | 60 (0.41)     |
| 700 (4.8)   | 55 (0.38)  | 50 (0.35)     |
| <b>Hollow loadbearing CMU, <math>t \geq 12</math> in (305 mm)<sup>D</sup>:</b>                    |  |               |
| 2,000 (14) or greater   | 115 (0.79)   | 100 (0.69)    |
| 1,500 (10)  | 95 (0.66)  | 85 (0.59)     |
| 1,000 (6.9)   | 60 (0.41)  | 55 (0.38)     |
| 700 (4.8)   | 50 (0.35)  | 45 (0.31)     |
| <b>Hollow walls (noncomposite masonry bonded<sup>B</sup>):</b>                                    |  |               |
| $t \leq 8$ in. (203 mm) <sup>D</sup>  |  |               |
|   | 75 (0.52)  | 70 (0.48)     |
| $8 < t < 12$ in (203 to 305 mm) <sup>D</sup>  |  |               |
|   | 70 (0.48)  | 65 (0.45)     |
| $t \geq 12$ in (305 m.m) <sup>D</sup>   |  |               |
|   | 60 (0.41)  | 55 (0.38)     |



## Empirical Concrete Masonry

Procedure using TMS 402 - 2016

Given: location, geometry, material

Find: strength (load capacity)

1. Check axial loading – must be within middle 1/3
2. Check seismic category to be A, B, or C, or only A if part of the seismic lateral force resisting system.
3. Check wind speed (ASCE-7 2016) compare with Tab. A.1.1
4. Check minimum thickness.  
1 story = 6" min. 2 story = 8" min.
5. Check lateral support (vertical or horizontal) tables 2 and 3 TEK 14-8B or TMS 402 – Tab. A.5.1
6. Determine allowable compressive stress from table 4 TEK 14-8B or TMS 402 – Tab. A.4.2
7. Allowable load = (stress) (gross area)

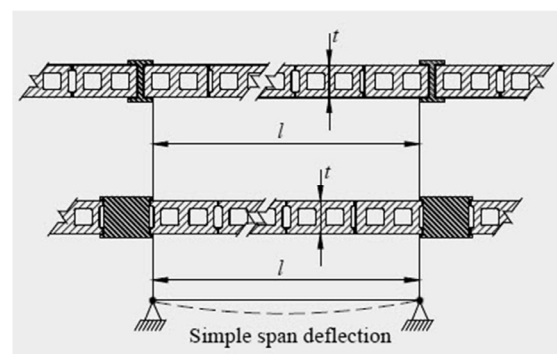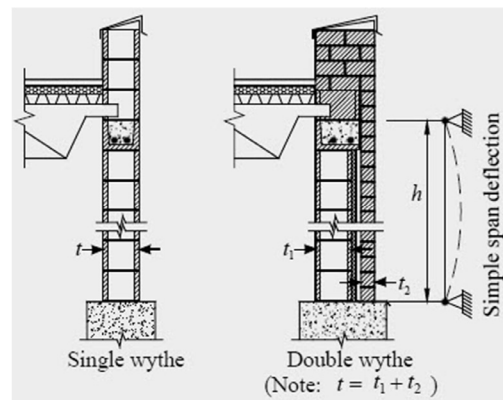

$$P = F \times A_g$$



# Empirical Design Example

Given:

8" hollow non-reinforced CMU wall  
 interior wall, Ann Arbor, Mich.  
 DL = 150 psf

Find:

LL capacity

Checks:

Axially loaded :


loaded within middle 1/3 (kern)

Seismic Category:

A, B, or C , or only A if part of the  
 seismic lateral force resisting  
 system

Wind:

less than 115 mph (ASCE 7 - 2016)

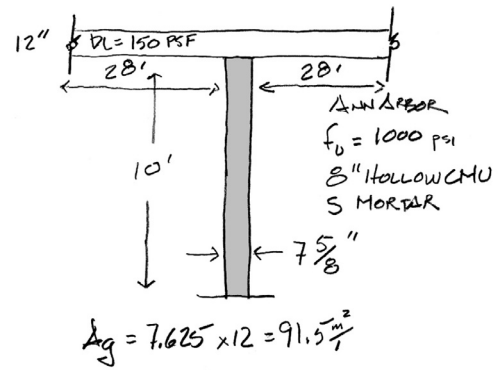

$$A_g = 7.625 \times 12 = 91.5 \text{ m}^2$$

AXIAL LOADING ✓

FOR ANN ARBOR :

SDC → A ✓

WIND LOAD 107 mph < 115 ✓

# Wind and Seismic Limits

Wind for Ann Arbor – 107 mph  
 SCD for Ann Arbor - Zones A

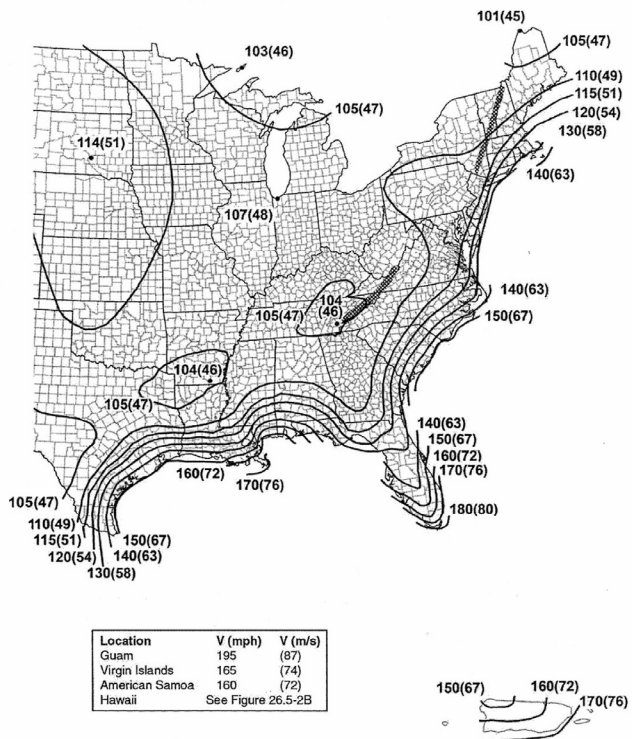
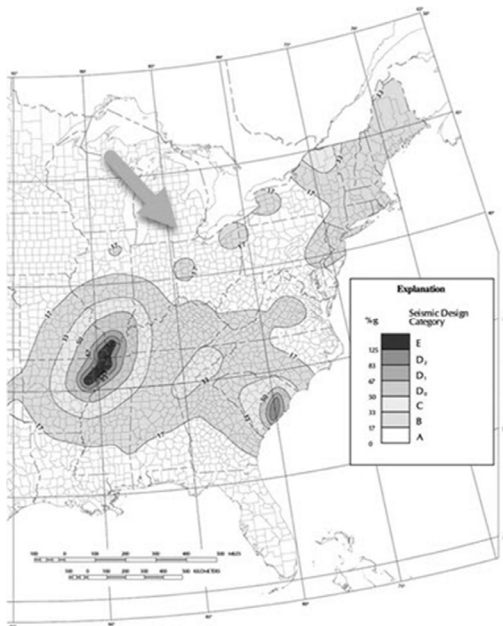


FIGURE 26.5-1B (Continued). Basic Wind Speeds for Risk Category II Buildings and Other Structures

# Empirical Design Example

Checks:

Maximum height – Table A.1.1

MAX HEIGHT  
TABLE 1 10' ✓

H/e (TABLE 2)  
 $\frac{120''}{8} = 15 < 18$  ✓

MAX. UNREINF. HEIGHT  
TABLE 3 → 10' < 12' ✓

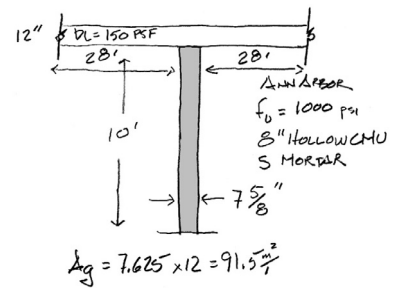


Table A.1.1 Limitations based on building height and basic wind speed

| Element Description   | Building Height, ft (m)                         | Basic Wind Speed, mph (mps) <sup>1</sup> |  |  |               |
|---|---|--|--|--|---------------|
|   |   | Less than or equal to 115 (51)           | Over 115 (51) and less than or equal to 120 (54) | Over 120 (54) and less than or equal to 125 (56) | Over 125 (56) |
| Masonry elements that are part of the lateral-force-resisting system  | 35 (11) and less                                | Permitted                                |  |  | Not Permitted |
|   | Over 180 (55)                                   | Not Permitted                            |  |  |               |
| Interior masonry loadbearing elements that are not part of the lateral-force-resisting system in buildings other than enclosed as defined by ASCE 7 | Over 60 (18) and less than or equal to 180 (55) | Permitted                                | Not Permitted                                    |  |               |
|   | Over 35 (11) and less than or equal to 60 (18)  | Permitted                                |  | Not Permitted                                    |               |
|   | 35 (11) and less                                | Permitted                                |  |  | Not Permitted |
| Exterior masonry elements that are not part of the lateral-force-resisting system   | Over 180 (55)                                   | Not Permitted                            |  |  |               |
|   | Over 60 (18) and less than or equal to 180 (55) | Permitted                                | Not Permitted                                    |  |               |
|   | Over 35 (11) and less than or equal to 60 (18)  | Permitted                                |  | Not Permitted                                    |               |
| Exterior masonry elements   | 35 (11) and less                                | Permitted                                |  |  | Not Permitted |

<sup>1</sup>Basic wind speed as given in ASCE 7

# Empirical Design Example

Checks:


Minimum bracing – table 2

Maximum unreinforced height - table 3

MAX HEIGHT  
TABLE 1 10' ✓

H/e (TABLE 2)  
 $\frac{120''}{8} = 15 < 18$  ✓

MAX. UNREINF. HEIGHT  
TABLE 3 → 10' < 12' ✓

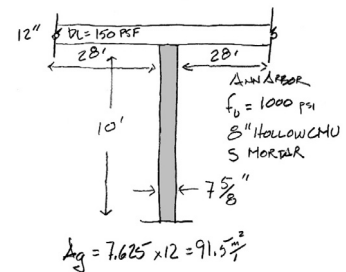

| Construction (unreinforced)                       | Maximum wall length-to thickness or height-to thickness ratio <sup>A</sup> |
|---|--|
| Bearing walls                                     |  |
| Solid units or solid grouted                      | 20   |
| All others  | 18   |
| Nonbearing walls                                  |  |
| Exterior  | 18   |
| Interior  | 36   |
| Cantilever walls <sup>B</sup>                     |  |
| Solid   | 6  |
| Hollow  | 4  |
| Parapets (8-in. (203-mm) thick min.) <sup>B</sup> | 3  |

| Wall thickness, in. (mm)      | 6 (152)               | 8 (203)    | 10 (254)   | 12 (305) |
|-------------------------------|-----------------------|------------|------------|----------|
| Bearing walls                 |                       |            |            |          |
| Solid or solid grouted        | 10 (3.0) <sup>B</sup> | 13.3 (4.1) | 16.6 (5.1) | 20 (6.1) |
| All other                     | 9 (2.7) <sup>B</sup>  | 12 (3.7)   | 15 (4.5)   | 18 (5.5) |
| Nonbearing walls              |                       |            |            |          |
| Exterior                      | 9 (2.7)               | 12 (3.7)   | 15 (4.5)   | 18 (5.5) |
| Interior                      | 18 (5.5)              | 24 (7.3)   | 30 (9.1)   | 36 (11)  |
| Cantilever Walls <sup>C</sup> |                       |            |            |          |
| Solid                         | 3 (0.9)               | 4 (1.2)    | 5 (1.5)    | 6 (1.8)  |
| Hollow                        | 2 (0.6)               | 2.6 (0.8)  | 3.3 (1.0)  | 4 (1.2)  |
| Parapets <sup>C</sup>         | 1.5 (0.5)             | 2 (0.6)    | 2.5 (0.8)  | 3 (0.9)  |

<sup>A</sup> Note that Ref. 6 includes modified requirements for walls with openings.

# Empirical Design Example

Find allowable stress – table 4

Find load


$$P = F A_g$$

Calculate per foot using gross Area

psi (Mpa)

psi (Mpa)

| Hollow Unit Masonry (Units Complying With ASTM C 90-06 or Later) (ref. 6) <sup>C</sup> : |                  |            |
|--|------------------|------------|
|  | Type M or S      | Type N     |
| Hollow loadbearing CMU, $t \leq 8$ in mortar   |                  |            |
| 2,000 (14) or greater  | 140 (0.97)       | 120 (0.83) |
| 1,500 (10)   | 115 (0.79)       | 100 (0.69) |
| <u>1,000 (6.9)</u>   | <u>75 (0.52)</u> | 70 (0.48)  |
| 700 (4.8)  | 60 (0.41)        | 55 (0.38)  |
| Hollow loadbearing CMU, 8 in. $< t < 12$ in. (203 to 305 mm) <sup>D</sup> :              |                  |            |
| 2,000 (14) or greater  | 125 (0.86)       | 110 (0.76) |
| 1,500 (10)   | 105 (0.72)       | 90 (0.62)  |
| 1,000 (6.9)  | 65 (0.49)        | 60 (0.41)  |
| 700 (4.8)  | 55 (0.38)        | 50 (0.35)  |
| Hollow loadbearing CMU, $t \geq 12$ in (305 mm) <sup>D</sup> :                           |                  |            |
| 2,000 (14) or greater  | 115 (0.79)       | 100 (0.69) |
| 1,500 (10)   | 95 (0.66)        | 85 (0.59)  |
| 1,000 (6.9)  | 60 (0.41)        | 55 (0.38)  |
| 700 (4.8)  | 50 (0.35)        | 45 (0.31)  |
| Hollow walls (noncomposite masonry bonded) <sup>B</sup> :                                |                  |            |
| $t \leq 8$ in. (203 mm) <sup>D</sup>   | 75 (0.52)        | 70 (0.48)  |
| $8 < t < 12$ in (203 to 305 mm) <sup>D</sup>   | 70 (0.48)        | 65 (0.45)  |
| $t \geq 12$ in (305 m.m) <sup>D</sup>  | 60 (0.41)        | 55 (0.38)  |

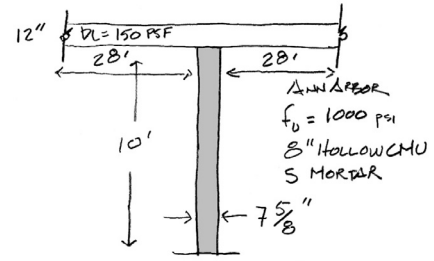

$$A_g = 7.625 \times 12 = 91.5 \text{ in}^2$$

TABLE 4 Hollow 8"  $f'_m = 1000$   
TYPE S  $\rightarrow$  75 PSI



$$P = F A_g = 75 (7.625 \times 12) = 6862 \text{ #/ft}$$

TRIBUTARY STRIP = 28'




$$P = 6862 = DL(28') + LL(28') = 150(28) + LL(28)$$

$$LL = 95 \text{ PSF CAPACITY}$$

## Clay Tile

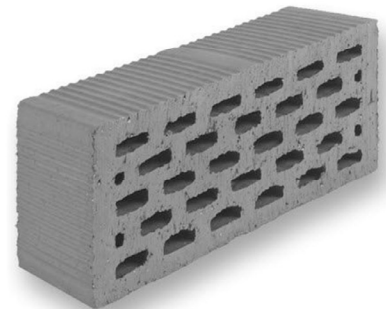

# Insulated Clay Tile

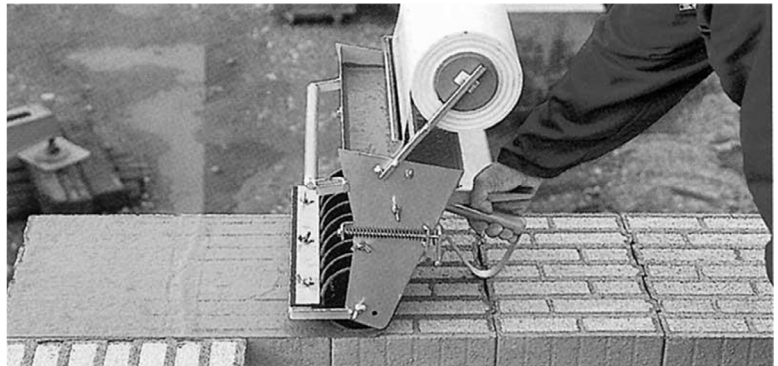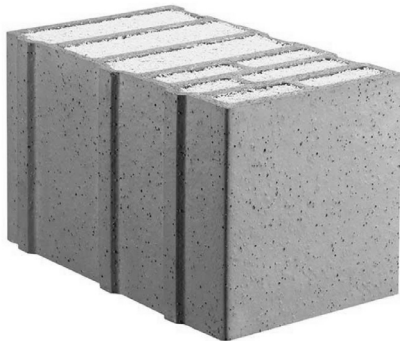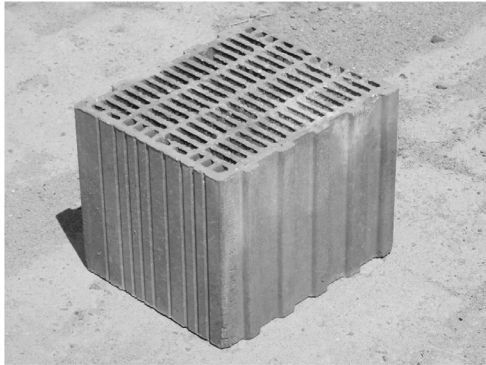

University of Michigan, TCAUP



Structures II

Slide 39 of 46

# Autoclaved Aeriated Concrete (AAC)

Used predominately in Europe  
 Developed by Dr. Johan Axel Eriksson in mid- 1920s in Sweden as "Ytong"  
 since 1943, Hebel blocks in Germany  
 Current largest production in China

- Lighter weight
- Better insulation value
- Better fire resistance
- Better moisture transmission
- Larger blocks for faster erection
- Can be shaped on site

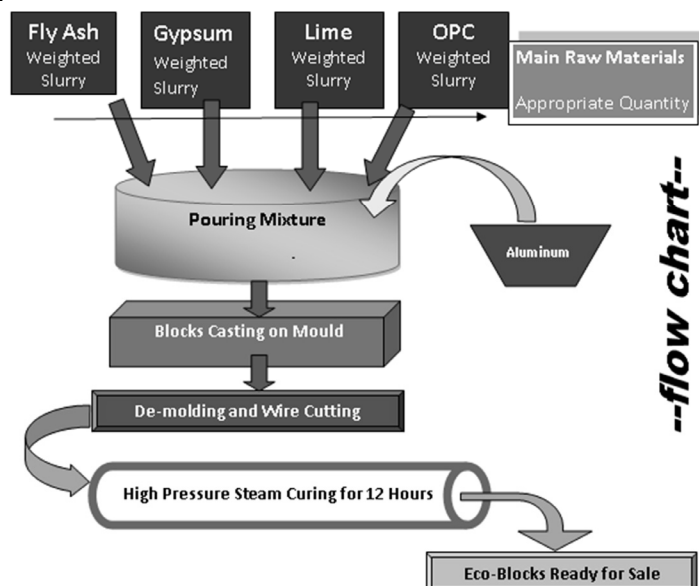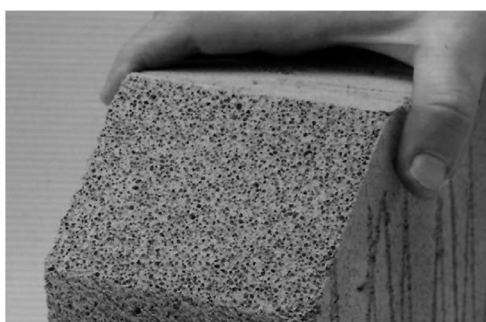

University of Michigan, TCAUP

Structures II

Slide 40 of 46




# Autoclaved Aeriated Concrete (AAC)

Density – 20 to 50 PCF (floats)

Compressive strength – 300 to 900 PSI

Allowable Shear Stress – 8 to 22 PSI

Thermal Resistance - 0.8 to 1.25 R/ IN

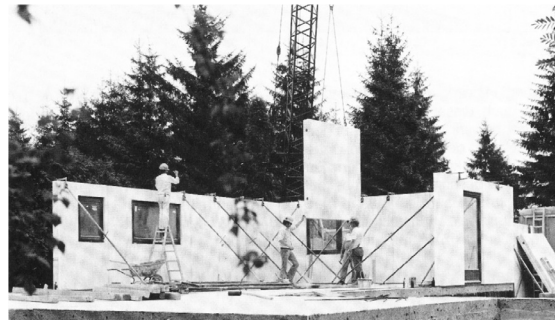

University of Michigan, TCAUP

Structures II







Slide 41 of 46

# Autoclaved Aeriated Concrete (AAC)

Easily shaped on site

Thin mortar bed – 1/8" (1mm to 3mm)

Tools for placement (below)

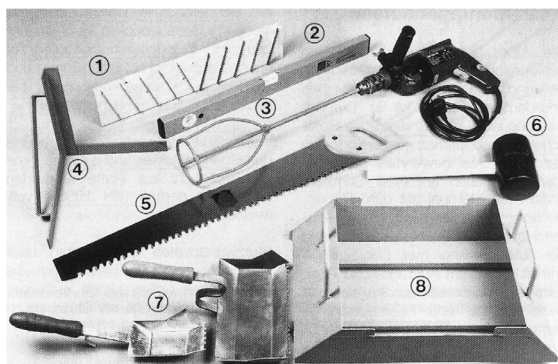

University of Michigan, TCAUP



Structures II

Slide 42 of 46

# Autoclaved Aeriated Concrete (AAC)

Larger blocks so faster layup – e.g. 8"x8"x24"


Panel layup with onsite crane

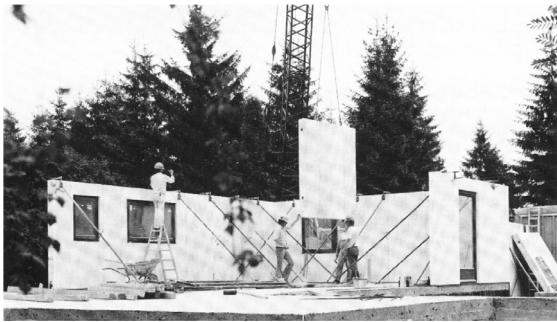

University of Michigan, TCAUP


Structures II

Slide 43 of 46

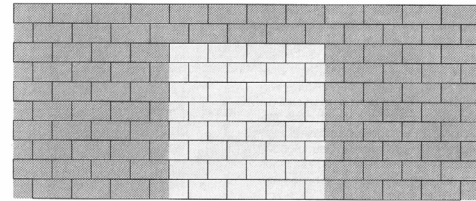


Clay block  
32 blocks / m<sup>2</sup>  
9.4" x 4.4"

Konventionelles Mauerwerk:  
32 Steine 2 DF/3 DF für 1 m<sup>2</sup> Wand;  
Steinmaß 240 mm x 113 mm x d

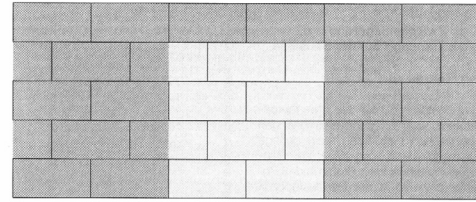

AAC block  
8 blocks / m<sup>2</sup>  
19.6" x 9.8"

Porenbeton-Plansteine:  
8 Steine pro 1 m<sup>2</sup> Wand;  
Steinmaß 498 mm x 249 mm x d

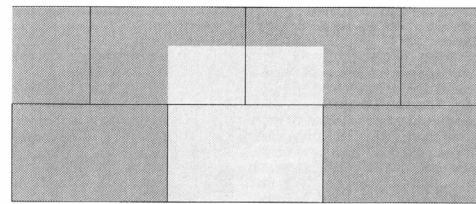

AAC panel  
1.6 panels / m<sup>2</sup>  
39.3" x 24.5"

Porenbeton-Planellemente:  
1,6 Steine pro 1 m<sup>2</sup> Wand;  
Steinmaß 999 mm x 623 mm x d

# Autoclaved Aeriated Concrete (AAC)

Finish with stucco




Abb. 2.4.4-1  
Anbringen der Sockelabschluß- und Eckschutzschiene zur Sicherung der Mauerwerkskanten



Abb. 2.4.4-2  
Auftrag des Grundputzes von Hand



Abb. 2.4.4-3  
Auftrag der Deckschicht




Abb. 2.4.4-4  
Verreiben der Putzoberfläche mit Filzbrett oder Schwammscheibe




University of Michigan, TCAUP

Structures II


Slide 44 of 46

# Member Types

Compression members based on proportions.




(a) Wall



(b) Pier

$$3T < L \leq 6T$$



(c) Column

$$H/D \geq 3$$



(d) Pedestal

$$H/D < 3$$

FIGURE 4.6. Classification of vertical compression members.


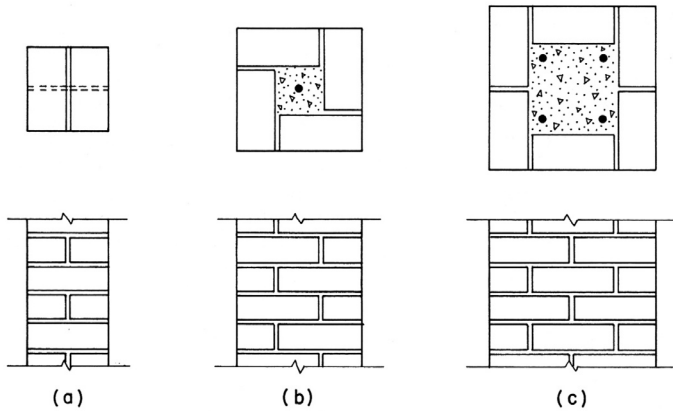



FIGURE 4.12. Forms of brick columns.

# Member Details

Floor / Column details.

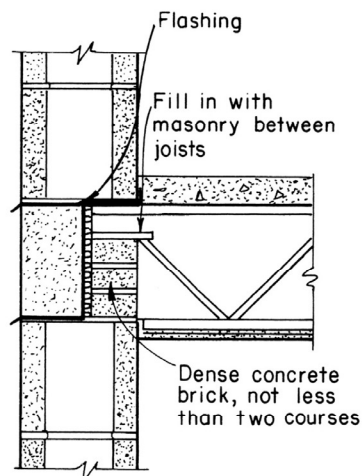

(a) Bar joist floor

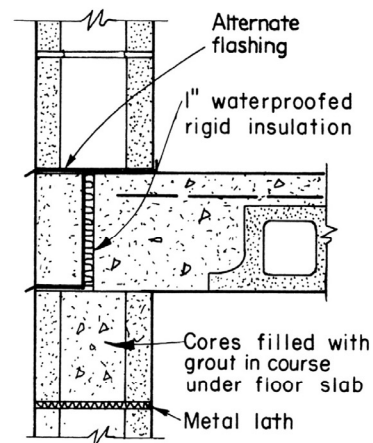

(b) Soffit block joist floor