

Wood Column Design

- Design of Wood Columns
- Stud Wall Design



Timber Column Design

Given:

- Lumber species, grade
- Conditions of use
- Load

Required:

- column size
1. Find adjustment factors (all except C_p)
 $C_D C_M C_t C_F C_i$
 2. Guess C_p
 3. Estimate Area and d (based on bracing)
 4. Calculate slenderness ratio l_e/d
largest ratio governs. Must be < 50
 5. Calculate C_p
 6. Determine F'_c by multiplying the tabulated F_c by all the above factors
 7. Revise Area: $A = P/F'_c$
 8. Revise C_p
 9. Repeat until $F'_c > P/A$



Timber Column Design

Given:

- White Oak, No.1 $F_c = 825$ psi
- dry use, normal temp., not incised
- Load: $D+L=55$ psf

Required:

- column size
- Find adjustment factors (all except C_p)
 $C_D C_M C_t C_F C_i$
 - Guess $C_p \rightarrow$ try 0.5

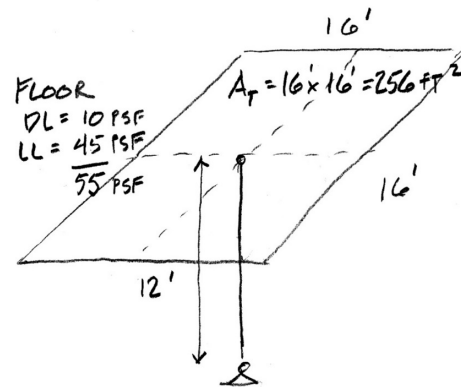


Table 4D Reference Design Values for Visually Graded Timbers (5" x 5" and larger)^{1,3}
(Tabulated design values are for normal load duration and dry service conditions, unless specified otherwise. See NDS 4.3 for a comprehensive description of design value adjustment factors.)

USE WITH TABLE 4D ADJUSTMENT FACTORS

Species and commercial Grade	Size classification	Design values in pounds per square inch (psi)							Specific Gravity ⁴	Grading Rules Agency
		Bending F_b	Tension parallel to grain F_t	Shear parallel to grain F_v	Compression perpendicular to grain $F_{c\perp}$	Compression parallel to grain F_c	Modulus of Elasticity			
							E	E_{min}		
WHITE OAK										
Select Structural No.1	Beams and Stringers	1,400	825	205	800	900	1,000,000	370,000	0.73	NELMA
No.2		1,200	575	205	800	775	1,000,000	370,000		
Select Structural No.1	Posts and Timbers	1,300	875	205	800	950	1,000,000	370,000		
No.2		1,050	700	205	800	825	1,000,000	370,000		


Timber Column Design

Given:

- White Oak, No. 1 $F_c = 825$ psi
- dry use, normal temp., not incised
- Load: $D+L=55$ psf, $P = 14080$ lbs

Required:

- column size

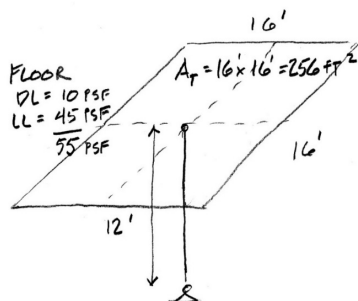

Size Factor, C_F

When visually graded timbers are subjected to loads applied to the narrow face, tabulated design values shall be multiplied by the following size factors:

Size Factors, C_F

Depth	F_b	F_t	F_c
$d > 12"$	$(12/d)^{1.9}$	1.0	1.0
$d \leq 12"$	1.0	1.0	1.0

ESTIMATE SIZE:

$$\text{GUESS } C_p = 0.5$$

$$A = \frac{P}{F'_c} = \frac{14080}{825(0.5)} = 34 \text{ in}^2$$

TRY:

$$\sqrt{A} = d \quad \sqrt{34} = 5.8$$

say 5.5" x 5.5"

TRY 6x6

$$\frac{P_e}{d} = \frac{(1)144}{5.5} = 26.18$$

- Find adjustment factors (all except C_p)
 $C_D C_M C_t C_F C_i = 1.0$
- Guess $C_p \rightarrow$ try 0.5
- Estimate Area and d (based on bracing)
- Calculate slenderness ratio l_e/d
largest ratio governs. Must be < 50

Timber Column Design

Given:

- White Oak, No. 1
- dry use, normal temp., not incised
- Load: D+L=55 psf

CHECK C_p ON GRAPH - ADJUST IF NEEDED

$$F_{CE} = \frac{0.822(370000)}{26.18^2} = 443.7 \text{ psi}$$

$$F_c^* = F_c (C_D C_M C_F C_t C_i) = 825 \text{ psi}$$

Required:


- column size

$$\frac{F_{CE}}{F_c^*} = \frac{443.7}{825} = 0.5378$$

5. Calculate C_p

$$C_p = \frac{1+0.5378}{2(0.8)} - \sqrt{\left[\frac{1+0.5378}{2(0.8)}\right]^2 - \frac{0.5378}{0.8}}$$

$$C_p = 0.46$$

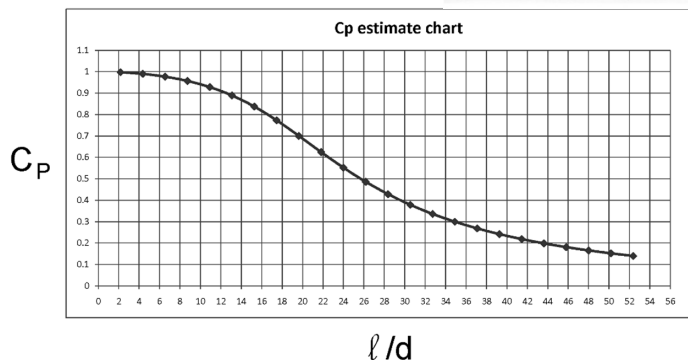

Timber Column Design

Given:

- White Oak, No. 1 $F_c = 825 \text{ psi}$
- dry use, normal temp., not incised
- Load: D+L=55 psf

Required:

- column size

REVISED F_c'

$$F_c' = 825(0.46) = 379.5$$

$$A = \frac{P}{F_c'} = \frac{14080^*}{379.5 \text{ psi}} = 37.1 \text{ in}^2$$

$$6 \times 6: A = 30.25 < 37.1 \therefore \text{FAILS}$$

$$6 \times 8 = 48 \text{ in}^2 > 37.1$$

6. Determine F_c' by multiplying the tabulated F_c by all the above factors

7. Revise Area: $A = P/F_c'$

8. Revise C_p

9. Repeat until $F_c' > P/A$

TRY 6×8

$$l_e/d = \frac{144''}{5.5''} = 26.18$$

(SAME AS 6×6)

$$C_p = 0.46 \text{ (NO CHANGE)}$$

$$F_c' = 379.5 \text{ psi}$$

$$P/A = \frac{14080^*}{41.25 \text{ in}^2} = 341.3 \text{ psi}$$

$$379.5 > 341.3 \therefore \text{OK} \checkmark$$

Table 1B Section Properties of Standard Dressed

Nominal Size b x d	Standard Dressed Size (S4S) b x d in. x in.	Area of Section A in. ²	X-X AXIS		Y-Y AXIS	
			Section Modulus S_{xx} in. ³	Moment of Inertia I_{xx} in. ⁴	Section Modulus S_{yy} in. ³	Moment of Inertia I_{yy} in. ⁴
Timbers (5" x 5" and larger) ²						
Post and Timber (see NDS 4.1.3.4 and NDS 4.1.5.3)						
5 x 5	4-1/2 x 4-1/2	20.25	15.19	34.17	15.19	34.17
6 x 6	5-1/2 x 5-1/2	30.25	27.73	76.26	27.73	76.26
6 x 8	5-1/2 x 7-1/2	41.25	51.56	193.4	37.81	104.0
8 x 8	7-1/2 x 7-1/2	56.25	70.31	263.7	70.31	263.7
8 x 10	7-1/2 x 9-1/2	71.25	112.8	535.9	89.06	334.0

Timber Column Design

Design Aids

example of a column chart

P = 14080 lbs

from AWC Manual for Engineered Wood Construction – 2005

Table M4.5-2a ASD Column Capacity^{1,2,3,4,5} (P', P_x, P_y), Timbers
6-inch nominal thickness (5.5 inch dry dressed size), C_D = 1.0.

Species	Column Length (ft)	Column Capacity (lbs)									
		Select Structural			No. 1			No. 2			
		6 x 6 6" width (=5.5")	6 x 8 8" width (=7.5")		6 x 6 6" width (=5.5")	6 x 8 8" width (=7.5")		6 x 6 6" width (=5.5")	6 x 8 8" width (=7.5")		
P'	P _x	P _y	P'	P _x	P _y	P'	P _x	P _y			
Douglas Fir-Larch	2	34,500	47,200	47,000	30,000	41,100	40,900	21,000	28,800	28,700	
	4	33,400	46,400	45,500	29,200	40,500	39,800	20,500	28,400	28,000	
	6	31,100	45,000	42,500	27,600	39,500	37,600	19,600	27,800	26,700	
	8	27,300	42,700	37,300	24,800	37,800	33,800	18,000	26,800	24,500	
	10	22,300	39,200	30,400	20,800	35,300	28,500	15,700	25,400	21,400	
	12	17,500	34,600	23,900	16,800	31,800	22,900	13,000	23,400	17,700	
Hem-Fir	2	29,200	40,000	39,800	25,500	34,900	34,800	17,300	23,600	23,600	
	4	28,200	39,300	38,500	24,800	34,400	33,800	16,900	23,400	23,000	
	6	26,200	38,100	35,800	23,300	33,500	31,800	16,100	22,900	22,000	
	8	22,800	36,000	31,100	20,800	31,900	28,400	14,900	22,100	20,300	
	10	18,400	32,900	25,100	17,400	29,700	23,700	13,100	21,000	17,800	
	12	14,300	28,800	19,600	13,800	26,800	18,900	10,900	19,400	14,800	
Southern Pine	2	28,500	39,000	38,900	24,800	33,900	33,800	15,800	21,600	21,500	
	4	27,700	38,500	37,800	24,200	33,500	33,000	15,500	21,400	21,100	
	6	26,200	37,500	35,700	23,100	32,800	31,500	15,000	21,000	20,400	
	8	23,500	35,900	32,100	21,200	31,600	28,900	14,100	20,500	19,200	
	10	19,900	33,500	27,100	18,400	29,900	25,100	12,700	19,700	17,400	
	12	16,000	30,200	21,800	15,200	27,500	20,700	11,000	18,500	15,000	
Spruce-Pine-Fir	2	24,000	32,900	32,700	21,000	28,800	28,700	15,000	20,600	20,500	
	4	23,400	32,400	31,900	20,500	28,400	28,000	14,700	20,300	20,100	
	6	22,100	31,600	30,100	19,600	27,800	26,700	14,100	19,900	19,300	
	8	19,900	30,300	27,100	18,000	26,800	24,500	13,100	19,300	17,900	
	10	16,800	28,300	23,000	15,700	25,400	21,400	11,600	18,400	15,800	
	12	13,600	25,600	18,500	13,000	23,400	17,700	9,800	17,100	13,400	

1. P' values are based on a column continuously braced against weak axis buckling.
 2. P_x values are based on a column continuously braced against strong axis buckling.
 3. To obtain LRFD capacity, see NDS Appendix N.
 4. Tabulated values apply to members in a dry service condition, C_D = 1.0; normal temperature range, C_t = 1.0; and unincised members, C_i = 1.0.
 5. Column capacities are based on concentric axial loads only and pin-pin end conditions (K_x = 1.0 per NDS Appendix Table G1).

4
M4: SAWN LUMBER

Stud Wall Design


Given:

- Lumber species, grade and size
- Conditions of use
- Load

Required:

- Stud spacing

1. Calculate slenderness ratio l_e/d
largest ratio governs. Must be < 50
2. Find adjustment factors (all except C_p)
C_D C_M C_t C_F C_i
3. Calculate C_p
4. Determine F'_c by multiplying the tabulated F_c by all the above factors
5. Set actual stress = allowable: $f_c = F'_c$
6. Find the capacity of one stud: P_{max} = F'_c A
7. Find allowable spacing (12", 16" or 24" o.c.)
8. Check bearing.

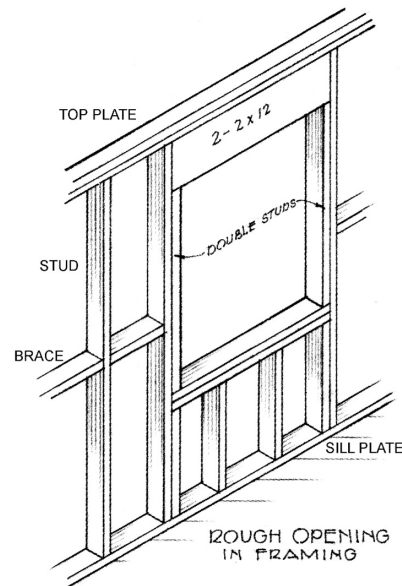


Stud Wall Example - design

Data:

- 2x6
- S-P-F, Stud M.C. = 12%
- D+L Load = 2500 PLF
- Braced as shown $K_e=1.0$

Required:

- o.c. spacing

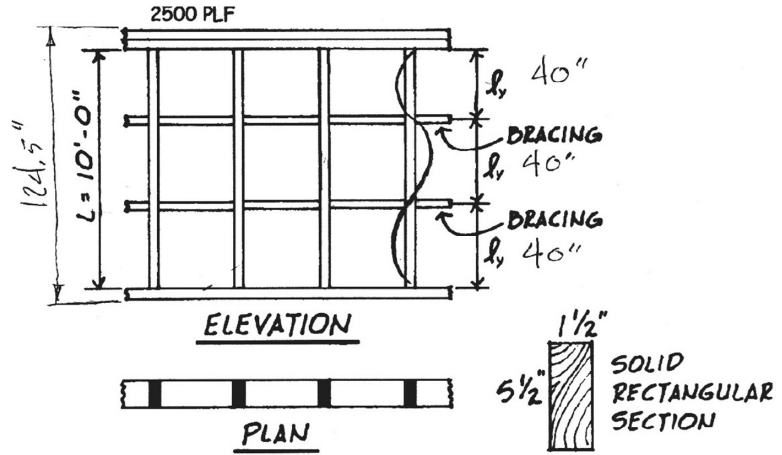

From NDS Supplement Table 4A

$$F_c = 725 \text{ psi}$$

$$E_{min} = 440000 \text{ psi}$$

$$C_D = 1.0 \text{ (LL)}$$

$$C_{Mc} = 1.0 \quad C_{ME} = 1.0$$

$$C_t = 1.0$$

$$C_F = 1.0 \text{ (stud)}$$

$$C_i = 1.0$$

$$C_P = ?$$

Table 4A (Cont.)

Reference Design Values for Visually Graded Dimension Lumber (2" - 4" thick)^{1,2,3}

(All species except Southern Pine—see Table 4B) (Tabulated design values are for normal load duration and dry service conditions. See NDS 4.3 for a comprehensive description of design value adjustment factors.)

USE WITH TABLE 4A ADJUSTMENT FACTORS

Species and commercial grade	Size classification	Design values in pounds per square inch (psi)						Modulus of Elasticity		Specific Gravity ⁴	Grading Rules Agency
		Bending F_b	Tension parallel to grain F_t	Shear parallel to grain F_v	Compression perpendicular to grain $F_{c\perp}$	Compression parallel to grain F_c	Modulus of Elasticity	E	E_{min}		
SPRUCE-PINE-FIR											
Select Structural		1,250	700	135	425	1,400	1,500,000	550,000			
No. 1/ No. 2	2" & wider	875	450	135	425	1,150	1,400,000	510,000			
No. 3		500	250	135	425	650	1,200,000	440,000			
Stud	2" & wider	875	350	135	425	725	1,200,000	440,000	0.42	NLGA	
Construction Standard		1,000	500	135	425	1,400	1,300,000	470,000			
Utility	2" - 4" wide	550	275	135	425	1,150	1,200,000	440,000			
		275	125	135	425	750	1,100,000	400,000			

Stud Wall Example - design


STUD WALL

S-P-F STUD GRADE

$$F_c = 725 \text{ psi}$$

$$E_{min} = 440,000 \text{ psi}$$

$$C_D = 1 \quad C_M = 1 \quad C_F = 1.0$$

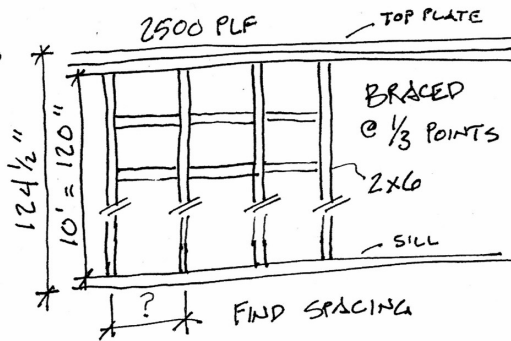

$$\begin{aligned}
 & X-X \quad \quad \quad Y-Y \\
 & l_{e_x} = 124.5" \\
 & \frac{l_e}{d} = \frac{124.5}{5.5} = 22.6 \\
 & \text{CONTROLLING } \frac{l_e}{d} = 26.7 \\
 & l_{e_y} = 40" \\
 & \frac{l_e}{d} = \frac{40}{1.5} = 26.7
 \end{aligned}$$

Stud Wall Example - design

C_p

X-X Y-Y

$$l_{e_x} = 124.5''$$

$$l_{e_y} = 40''$$

$$l_e/d = \frac{124.5}{5.5} = 22.6$$

$$l_e/d = \frac{40}{1.5} = 26.7$$

CONTROLLING $l_e/d = 26.7$


$$F_{CE} = \frac{0.822 E_{min}'}{(l_e/d)^2} = \frac{0.822 (440,000)}{26.7^2} = 508.6$$

$$F_c^* = 725 (1 \times 1 \times 1) = 725 \text{ psi}$$

$$F_{CE}/F_c^* = \frac{508.6}{725} = 0.702$$

NDS eq. 3.7-1 $\rightarrow C_p = 0.559$

Stud Wall Example - design

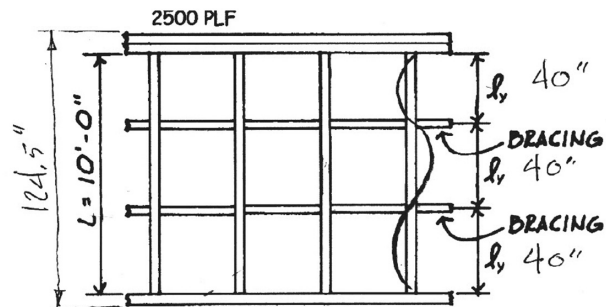

Find max allowable stress, F'_c

$$F'_c = 725 (0.559) = 405.6 \text{ psi}$$

Calculate max load per stud


$$P = F'_c A = 405.6 \text{ psi} \times 8.25 \text{ in}^2 = 3345 \text{ lbs}$$

Determine max stud spacing

$$\frac{2500 \text{ PLF}}{3345 \text{ LBS/STUD}} = \frac{12}{S} \rightarrow S = 16'' \text{ O.C. (ROUND DOWN)}$$

Stud Wall Example - design

Check bearing on sill plate
 For 2x6 $\ell_b = 1.5"$
 $C_b = 1.25$

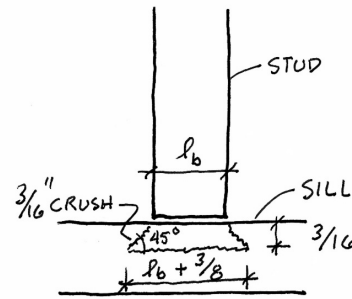

3.10.4 Bearing Area Factor, C_b

Reference compression design values perpendicular to grain, $F_{c\perp}$, apply to bearings of any length at the ends of a member, and to all bearings 6" or more in length and not nearer than 3" to the end of a member, the reference compression design value perpendicular to grain, $F_{c\perp}$, shall be permitted to be multiplied by the following bearing area factor, C_b :

$$C_b = \frac{\ell_b + 0.375}{\ell_b} \quad (3.10-2)$$

where:

ℓ_b = bearing length measured parallel to grain, in.

Equation 3.10-2 gives the following bearing area factors, C_b , for the indicated bearing length on such small areas as plates and washers:


ℓ_b	0.5"	1"	1.5"	2"	3"	4"	6" or more
C_b	1.75	1.38	1.25	1.19	1.13	1.10	1.00

For round bearing areas such as washers, the bearing length, ℓ_b , shall be equal to the diameter.

Stud Wall Example - design

Check bearing on sill plate

- determine C_b
- calculate $F'_{c\perp}$
- calculate $f_{c\perp}$
- check stress

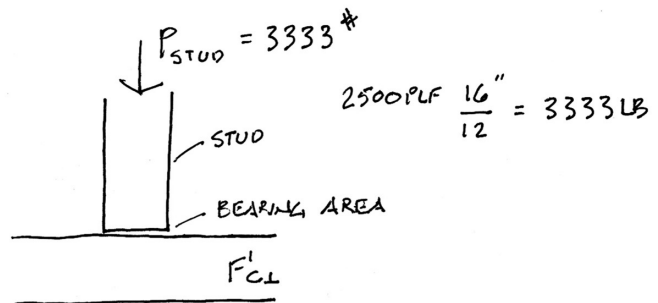

$b = 1.5"$
 $C_b = 1.25$

$F_{c\perp} = 425 \text{ psi}$ $F'_{c\perp} = 425(1.25) = 531 \text{ psi}$

$f_{c\perp} = \frac{P}{A} = \frac{3333 \#}{8.25 \text{ in}^2} = 404 \text{ psi}$

$f_{c\perp} = 404 < 531 = F'_{c\perp}$ ✓ OK

Table 4A Reference Design Values for Visually Graded Dim (2" - 4" thick)^{1,2,3}

(All species except Southern Pine—see Table 4B) (Tat duration and dry service conditions. See NDS 4.3 for a comp adjustment factors.)

USE WITH TABLE 4A ADJUSTMENT FAC

Species and commercial grade	Size classification	Design values in pounds per sq ft				
		Bending F_b	Tension parallel to grain F_t	Shear parallel to grain F_v	Compression perpendicular to grain $F_{c\perp}$	Cor p t
SPRUCE-PINE-FIR						
Select Structural		1,250	700	135	425	
No. 1/No. 2	2" & wider	875	450	135	425	
No. 3		500	250	135	425	
Stud	2" & wider	875	350	135	425	725
Construction		1,000	500	135	425	1,400
Standard	2" - 4" wide	550	275	135	425	1,150
Utility		275	125	135	425	750
						1,200,000
						440,000
						0.42
						NLGA